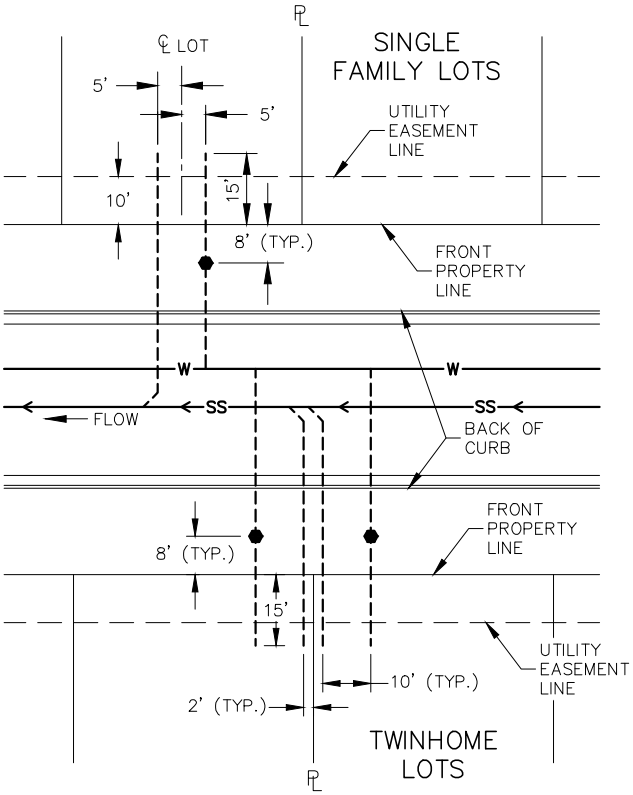




NOTES:

1. SERVICES INSTALLED AS SHOWN UNLESS SHOWN OTHERWISE ON PLANS.

2. TRENCH EXCAVATION LIMIT BEYOND PROPERTY LINE SHALL BE 20' FOR FRONT PROPERTY LINE AND 10' FOR SIDE PROPERTY LINE TO PREVENT EXCAVATION EXTENDING INTO BUILDING FOUNDATION AREA.

| TYPICAL SERVICE LAYOUT | | CITY ENGINEER APPROVED: BLO | DATE: 04.17.26 |
|---|---|---|---|
| SECTION No. 331417 | DRAWING No. 1 | PUBLIC WORKS APPROVED: RAS | DATE: 04.17.26 |
| CITY OF KINDRED ENGINEERING | | CITY COUNCIL APPROVED DATE: 05.06.26 | |

*FILE LOCATION: C:\Users\payton.sterud\OneDrive - Vistal\330561_Completed Redlines and Civil3D\Kindred Details-PSS.dwg*

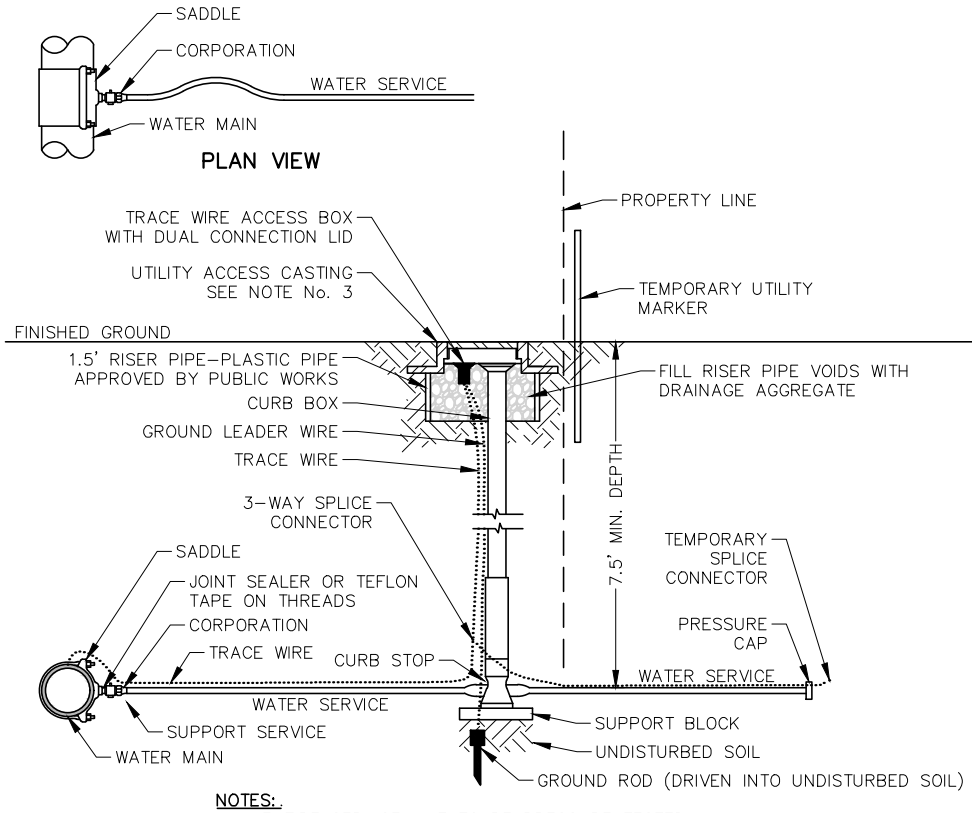



NOTES:.

1. ENTIRE SERVICE LINE TO BE PRESSURE TESTED.
2. SEE SERVICE LAYOUT DETAIL OR PLAN SHEETS FOR LOCATION OF CURB STOP AND END OF SERVICE.
3. SET CURB STOP AND TRACE WIRE ACCESS BOX 2–4" BELOW GRADE. CURB STOP TO BE HALFWAY EXTENDED. ENSURE CURB STOP AND TRACE WIRE ACCESS BOX ARE ACCESSIBLE WITHIN UTILITY CASTING.

| WATER SERVICE | | CITY ENGINEER APPROVED: BLO | DATE: 01.29.20 |
|---|---|---|---|
| SECTION No. 331417 | DRAWING No. 2 | PUBLIC WORKS APPROVED: RAS | DATE: 01.27.20 |
| CITY OF KINDRED ENGINEERING | | CITY COUNCIL APPROVED DATE: 02.05.20 | |

*FILE LOCATION: C:\Users\payton.sterud\OneDrive - Vistal\330561_Completed Redlines and Civil3D\Kindred Details-PSS.dwg*

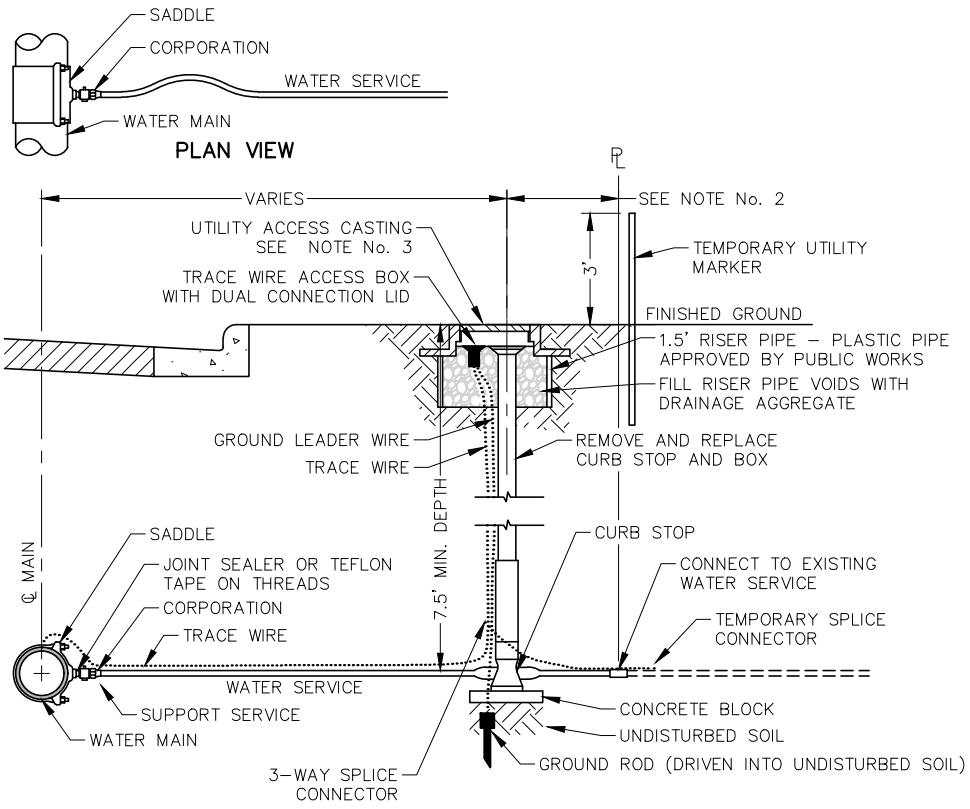


NOTES:

1. IF EXISTING WATER SERVICE HAS LESS THAN 7.5' COVER, ADJUST EXISTING SERVICE DOWN AS NEEDED TO PROVIDE 7.5' COVER AT NEW CURB STOP AND BOX.
2. DETERMINE LOCATION OF CURB STOP IN FIELD.
3. SET CURB STOP AND TRACE WIRE ACCESS BOX 2–4" BELOW GRADE. CURB STOP TO BE HALFWAY EXTENDED. ENSURE CURB STOP AND TRACE WIRE ACCESS BOX ARE ACCESSIBLE WITHIN UTILITY CASTING.

| WATER SERVICE REPLACEMENT | | CITY ENGINEER APPROVED: BLO | DATE: 01.29.20 |
|---|---|---|---|
| SECTION No. 331417 | DRAWING No. 3 | PUBLIC WORKS APPROVED: RAS | DATE: 01.27.20 |
| CITY OF KINDRED ENGINEERING | | CITY COUNCIL APPROVED DATE: 02.05.20 | |